


SCALE: NONE
 FORESTVILLE
 COUNTY
 WATER DISTRICT

DRAWN: J.H.
 CHECKED: J.S.L.
 APPROVED: G.R.
 REDUCED-PRESSURE
 BACKFLOW PREVENTER

DATE: OCT. 1995
 STD. NO.
 105

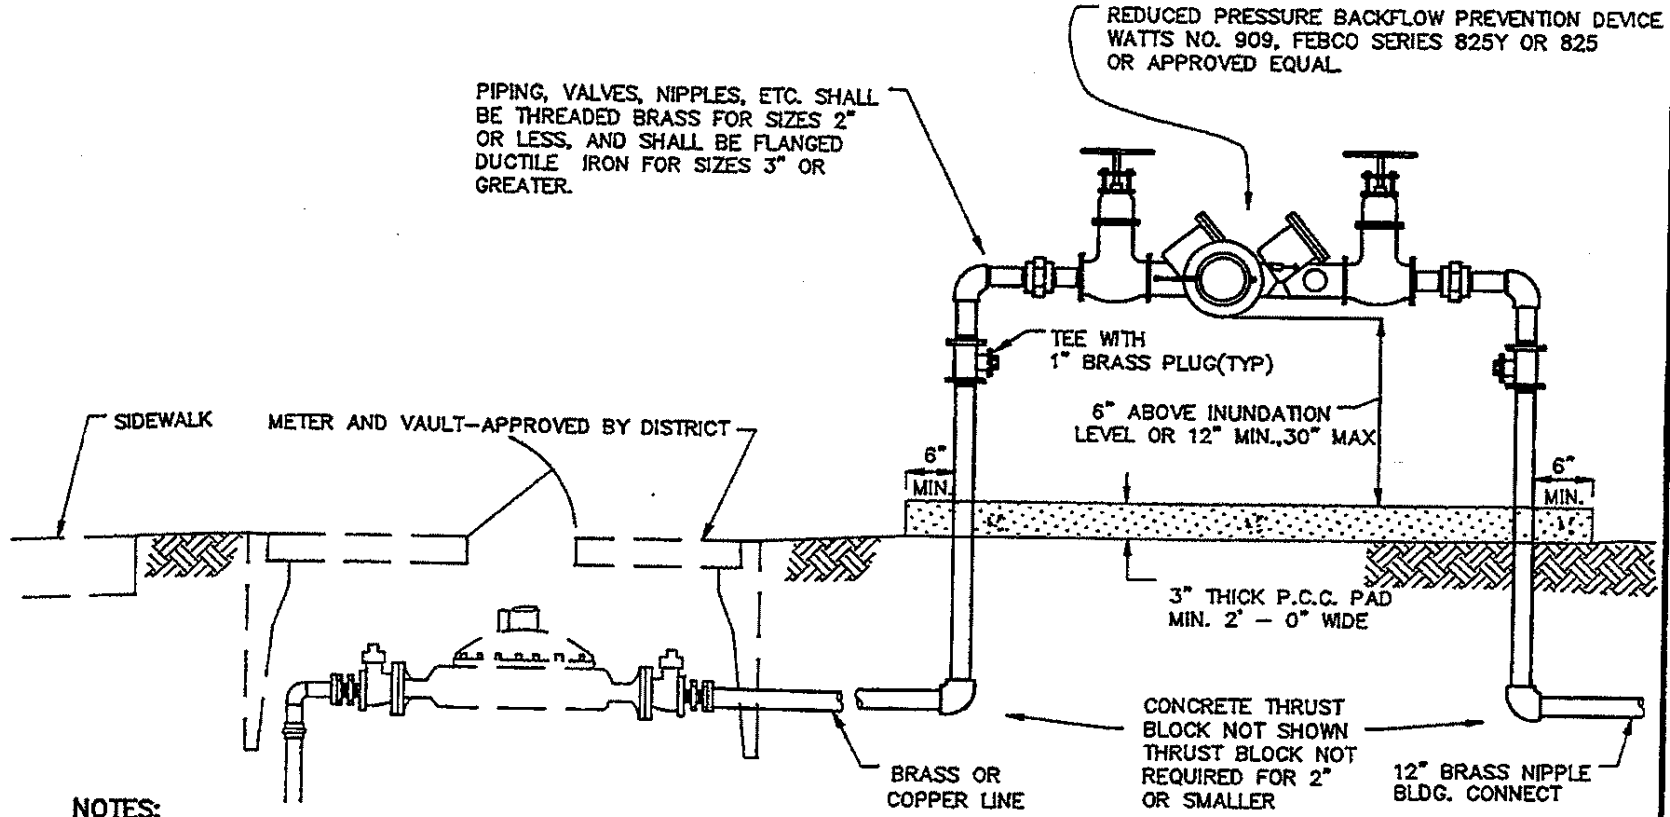

NOTES:

1. REDUCED - PRESSURE TYPE BACKFLOW PREVENTION DEVICES SHALL BE REQUIRED FOR ANY USE WHERE TOXIC MATERIALS ARE USED OR WHERE POSITIVE PROTECTION FOR THE PUBLIC WATER SUPPLY IS REQUIRED. TYPICAL APPLICATIONS INCLUDE: IRRIGATION SERVICES, COMMERCIAL SERVICES, INDUSTRIAL SERVICES, HOSPITALS, LABORATORIES, MORTUARIES, OR AS DETERMINED BY THE TOWN. (TITLE 17 CALIF. ADMINISTRATION CODE)
2. APPROVED REDUCED-PRESSURE TYPE BACKFLOW PREVENTION DEVICES SHALL BE AS LISTED BY THE UNIVERSITY OF SOUTHERN CALIFORNIA STUDY, LATEST REVISION.
3. BACKFLOW PREVENTION DEVICES SHALL BE INSTALLED ADJACENT TO AND ON THE PROPERTY SIDE OF SIDEWALK WHERE APPLICABLE. THE ASSEMBLY SHALL BE INSTALLED AS CLOSE TO THE WATER METER LOCATION AS PRACTICAL.
4. DEVICE TO BE SAME SIZE OR LARGER THAN SERVICE METER.
5. LANDSCAPING OR OTHER SCREENING AROUND THE BACKFLOW DEVICE SHALL BE AS SHOWN ON APPROVED PLANS.